



## Strength of Material Laboratory FRP Tests

According to ISO 10406-1 - 2015

Client , ARMASTEK SCIENTIFIC & PRODUCTION COMPANY LTD

27 a Fedoseeva Str. 614101 perm • Russian Fedration

Your Ref : verbal request , Jan/2020


### 1- Tensile Tests

Date , 27/01/2020

Ident.	Diameter (mm)		Average Cross Sectional Area (mm <sup>2</sup> )	Ultimate strength N/mm <sup>2</sup>		Remarks
	Nominal	Measured Aver.		Individuals	Average	
A	1	12	11.38	101.8	1177	1212
	2				1239	
	3				1221	
B	1	10	9.47	70.5	1397	1364
	2				1391	
	3				1304	
C	1	8	7.47	43.8	1279	1244
	2				1221	
	3				1231	
D	1	6	5.63	24.9	1096	1102
	2				1076	
	3				1133	

Eng. Abdelrahim

27/1/2020

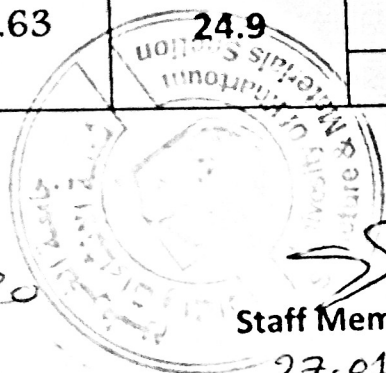

Staff Member Incharge

27.01.2020

Eng. Yahya Adam